

HBS-0060-1 SINGLE TOWER DESICCANT AIR DRYER **GENERAL ARRANGEMENT**

SHEET: 1 OF 2

OTHERWISE SPECIFIED:

TOLERANCES UNLESS

FRACTIONS =± 1/4 "

ANGLES $=\pm$ 3° INCHES = \pm 1/2 " REV. ECO.

0921

D


THE SPECIFICATIONS AND DRAWINGS DISCLOSED HEREIN ARE THE SOLE PROPERTY OF ALTEC AIR, AND SHALL NOT BE COPIED OR USED AS THE BASIS FOR SALE OR MANUFACTURE WITHOUT EXPRESS WRITTEN PERMISSION.


REVISION LOG		
DESCRIPTION	DATE	APPROVE
PRODUCTION UPDATES	12/23/2019	WS

DRAWN: MR

FINISH = 250

DRAWING NO. AT20-765 DATE: 3/11/2016 SCALE: N/A CHECKED: DATE: **-**-7 7/8 **-**-Ø3/8 34 32 23 1/2

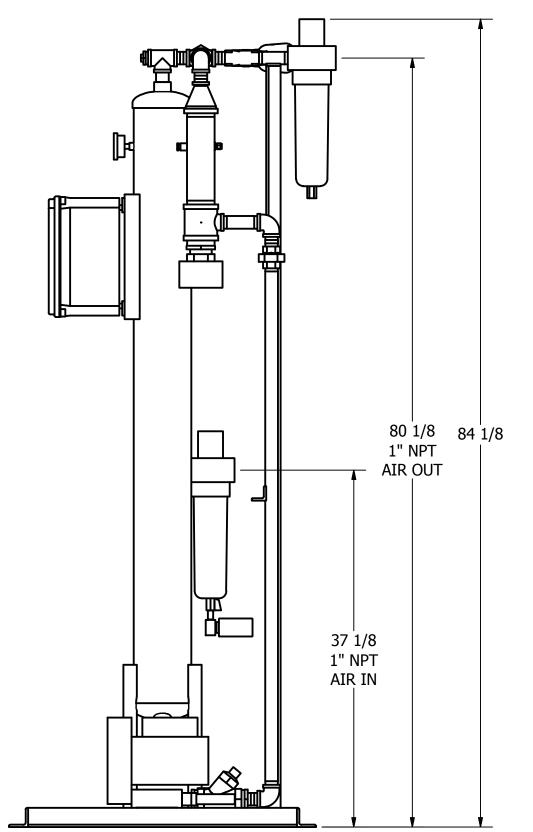

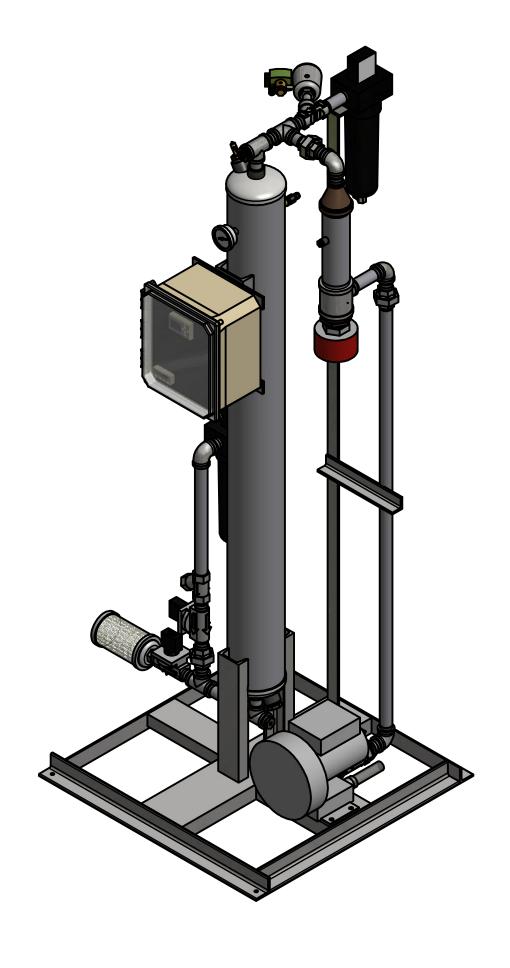

PRELIMINARY



HBS-0060-1 SINGLE TOWER DESICCANT AIR DRYER GENERAL ARRANGEMENT

DRAWING NO. AT20-765

TOLERANCES UNLESS OTHERWISE SPECIFIED:

FRACTIONS =± 1/4 "

REV.

D

ANGLES = \pm 3° INCHES = \pm 1/2 "

FINISH = 250

THE SPECIFICATIONS AND DRAWINGS DISCLOSED HEREIN ARE THE SOLE PROPERTY OF ALTEC AIR, AND SHALL NOT BE COPIED OR USED AS THE BASIS FOR SALE OR MANUFACTURE WITHOUT EXPRESS WRITTEN PERMISSION.

REVISION LOG

ITEM

REV.	ECO.	DESCRIPTION	DATE	APPROVED
D	0921	PRODUCTION UPDATES	12/23/2019	WS

PARTS LIST

DESCRIPTION

DRAWN: MR	DATE: 3/11/2016	D N/A	71120 700				I I EIVI	QIY	DESCRIPTION
CHECKED:	DATE:	SCALE: N/A	SHEET: 2 OF 2				1		ANGLE BODY VALVE, OUTLET
					5		2		PARTICULATE AFTER FILTER
					<u> </u>		3		RELIEF VALVE, TANK
							4	1	PRESSURE GAUGE, TANK
							5	1	MOISTURE INDICATOR
							6	1	1.5 KW HEATER
			lacksquare	3			7	1	COALESCER PRE-FILTER
							8	1	TIMED DRAIN
			(2)				9	1	CHECK VALVE, INLET
							10		SOLENOID VALVE, INLET
				(4)——		● (6)	11		SOLENOID VALVE, EXHAUST
							12		MUFFLER, EXHAUST
							13		1/2 HP BLOWER
						Щ.	14		CHECK VALVE, BLOWER
						W/W			DESICCANT
						N/991		1	
			8 12				PRELIM		ARY